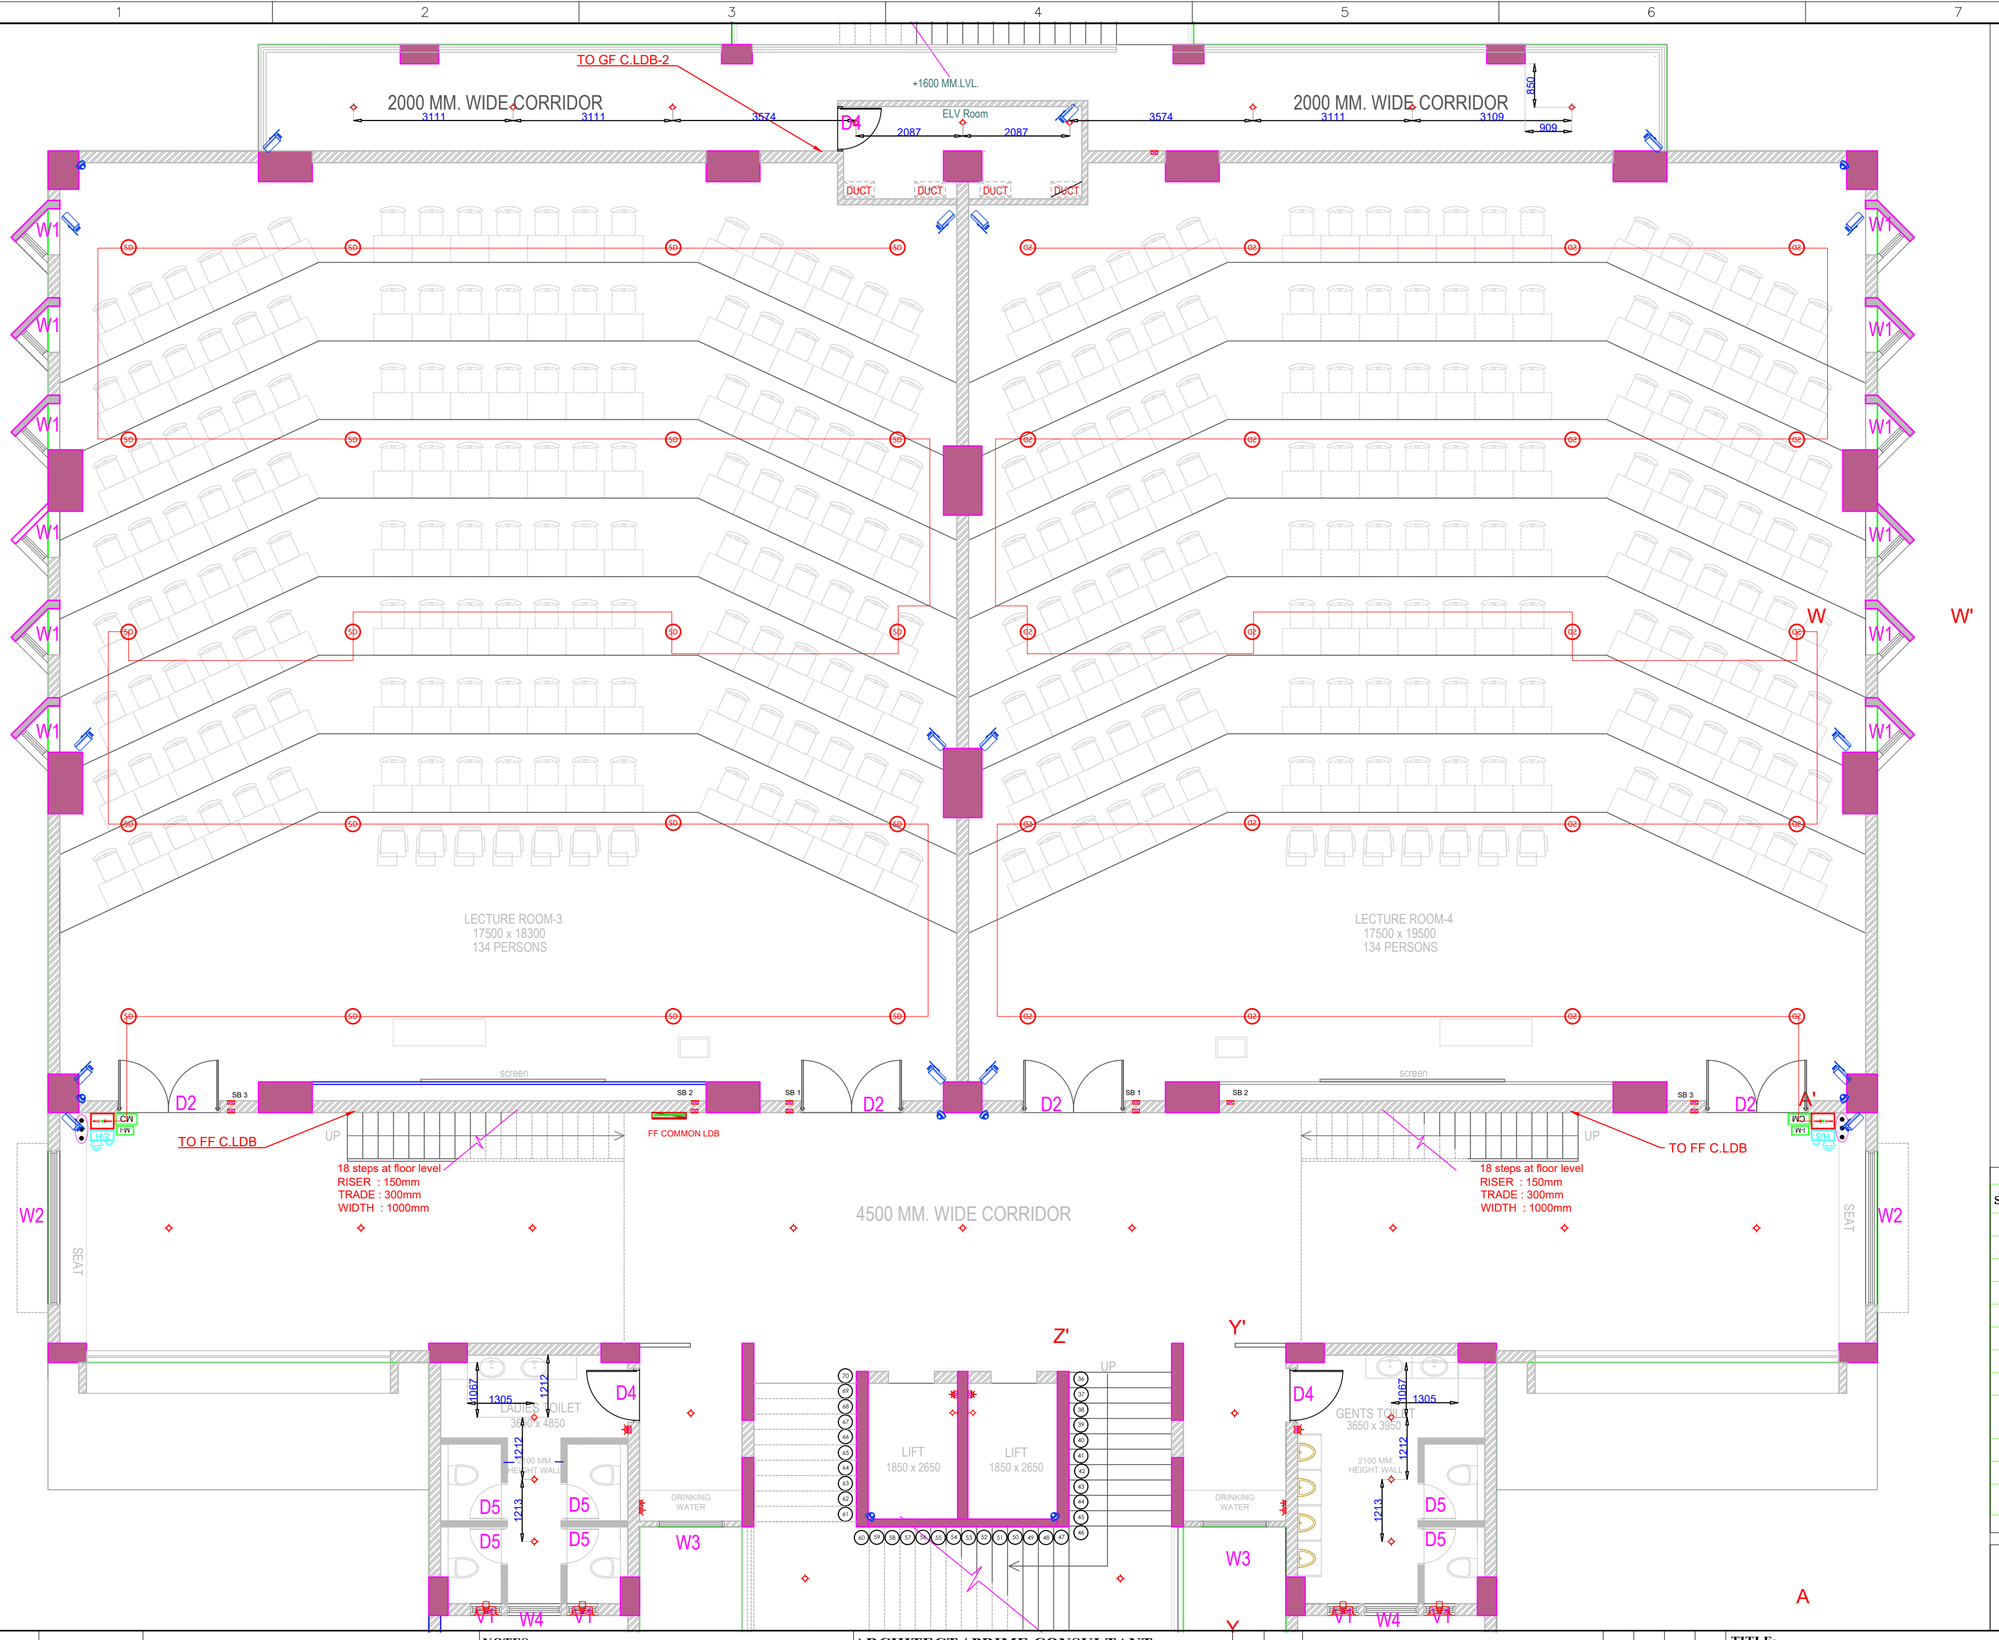

S.N	SYMBOL	DESCRIPTION	1&2 FLOOR QNTY	MAKE	APPROVAL
1	SD	SMOKE SENSOR DETECTOR–FC	80	SIMPLEX	UL/FM APPROVED
2	SD	SMOKE SENSOR DETECTOR–TC	00	SIMPLEX	
3	HD	HEAT SENSOR DETECTOR–TC	00	SIMPLEX	
4	MCP	MANUAL CALL POINT	04	SIMPLEX	
5	HCS	HOOTER CUM STOBE	04	SIMPLEX	
6	CM	CONTROL MODULE (FOR HOOTER)	04	SIMPLEX	
7	MM	MONIOR MODULE	00	SIMPLEX	
8	I-M	ISOLATOR MODULE	04	SIMPLEX	
9	PSU	POWER SUPPLY UNIT SUPPLY FROM 24 HRS UPS PROVIDED BY CLIENT	00		
10		2X1.5 SQ.MM DETECTION CABLE			
11		2X1.5 SQ.MM POWER CABLE			
12	FACP	FIRE ALARM PANEL (EXISTING)	--	SIMPLEX	

PROJECT:

DHIRUBHAI UNIVERSITY CLASSROOMS

REV.. R1

SCALE : NTS

NOTES:

ARCHITECT / PRIME CONSULTANT:

REV. NO	DATE	REVISIONS	BY	CHK.	DEPT. HEAD	PROJ. MGR.
1	25/08/26	FOR APPROVAL	DP	DP	JP	JP
0	24/04/26	FOR APPROVAL	DP	DP	JP	JP

DRAWING NO.	REFERENCE DRAWINGS

TITLE: FIRST FLOOR ELECTRICAL ELV LAYOUT

TORQUE ENGINEERING DESIGN CONSULTANT

Tel: +81281 88189 www.torqueelectricalservices.com

ENGINEERING DESIGN CONSULTANT

DRG. NO.: ELE-FF-ELV-01

REV. R1