


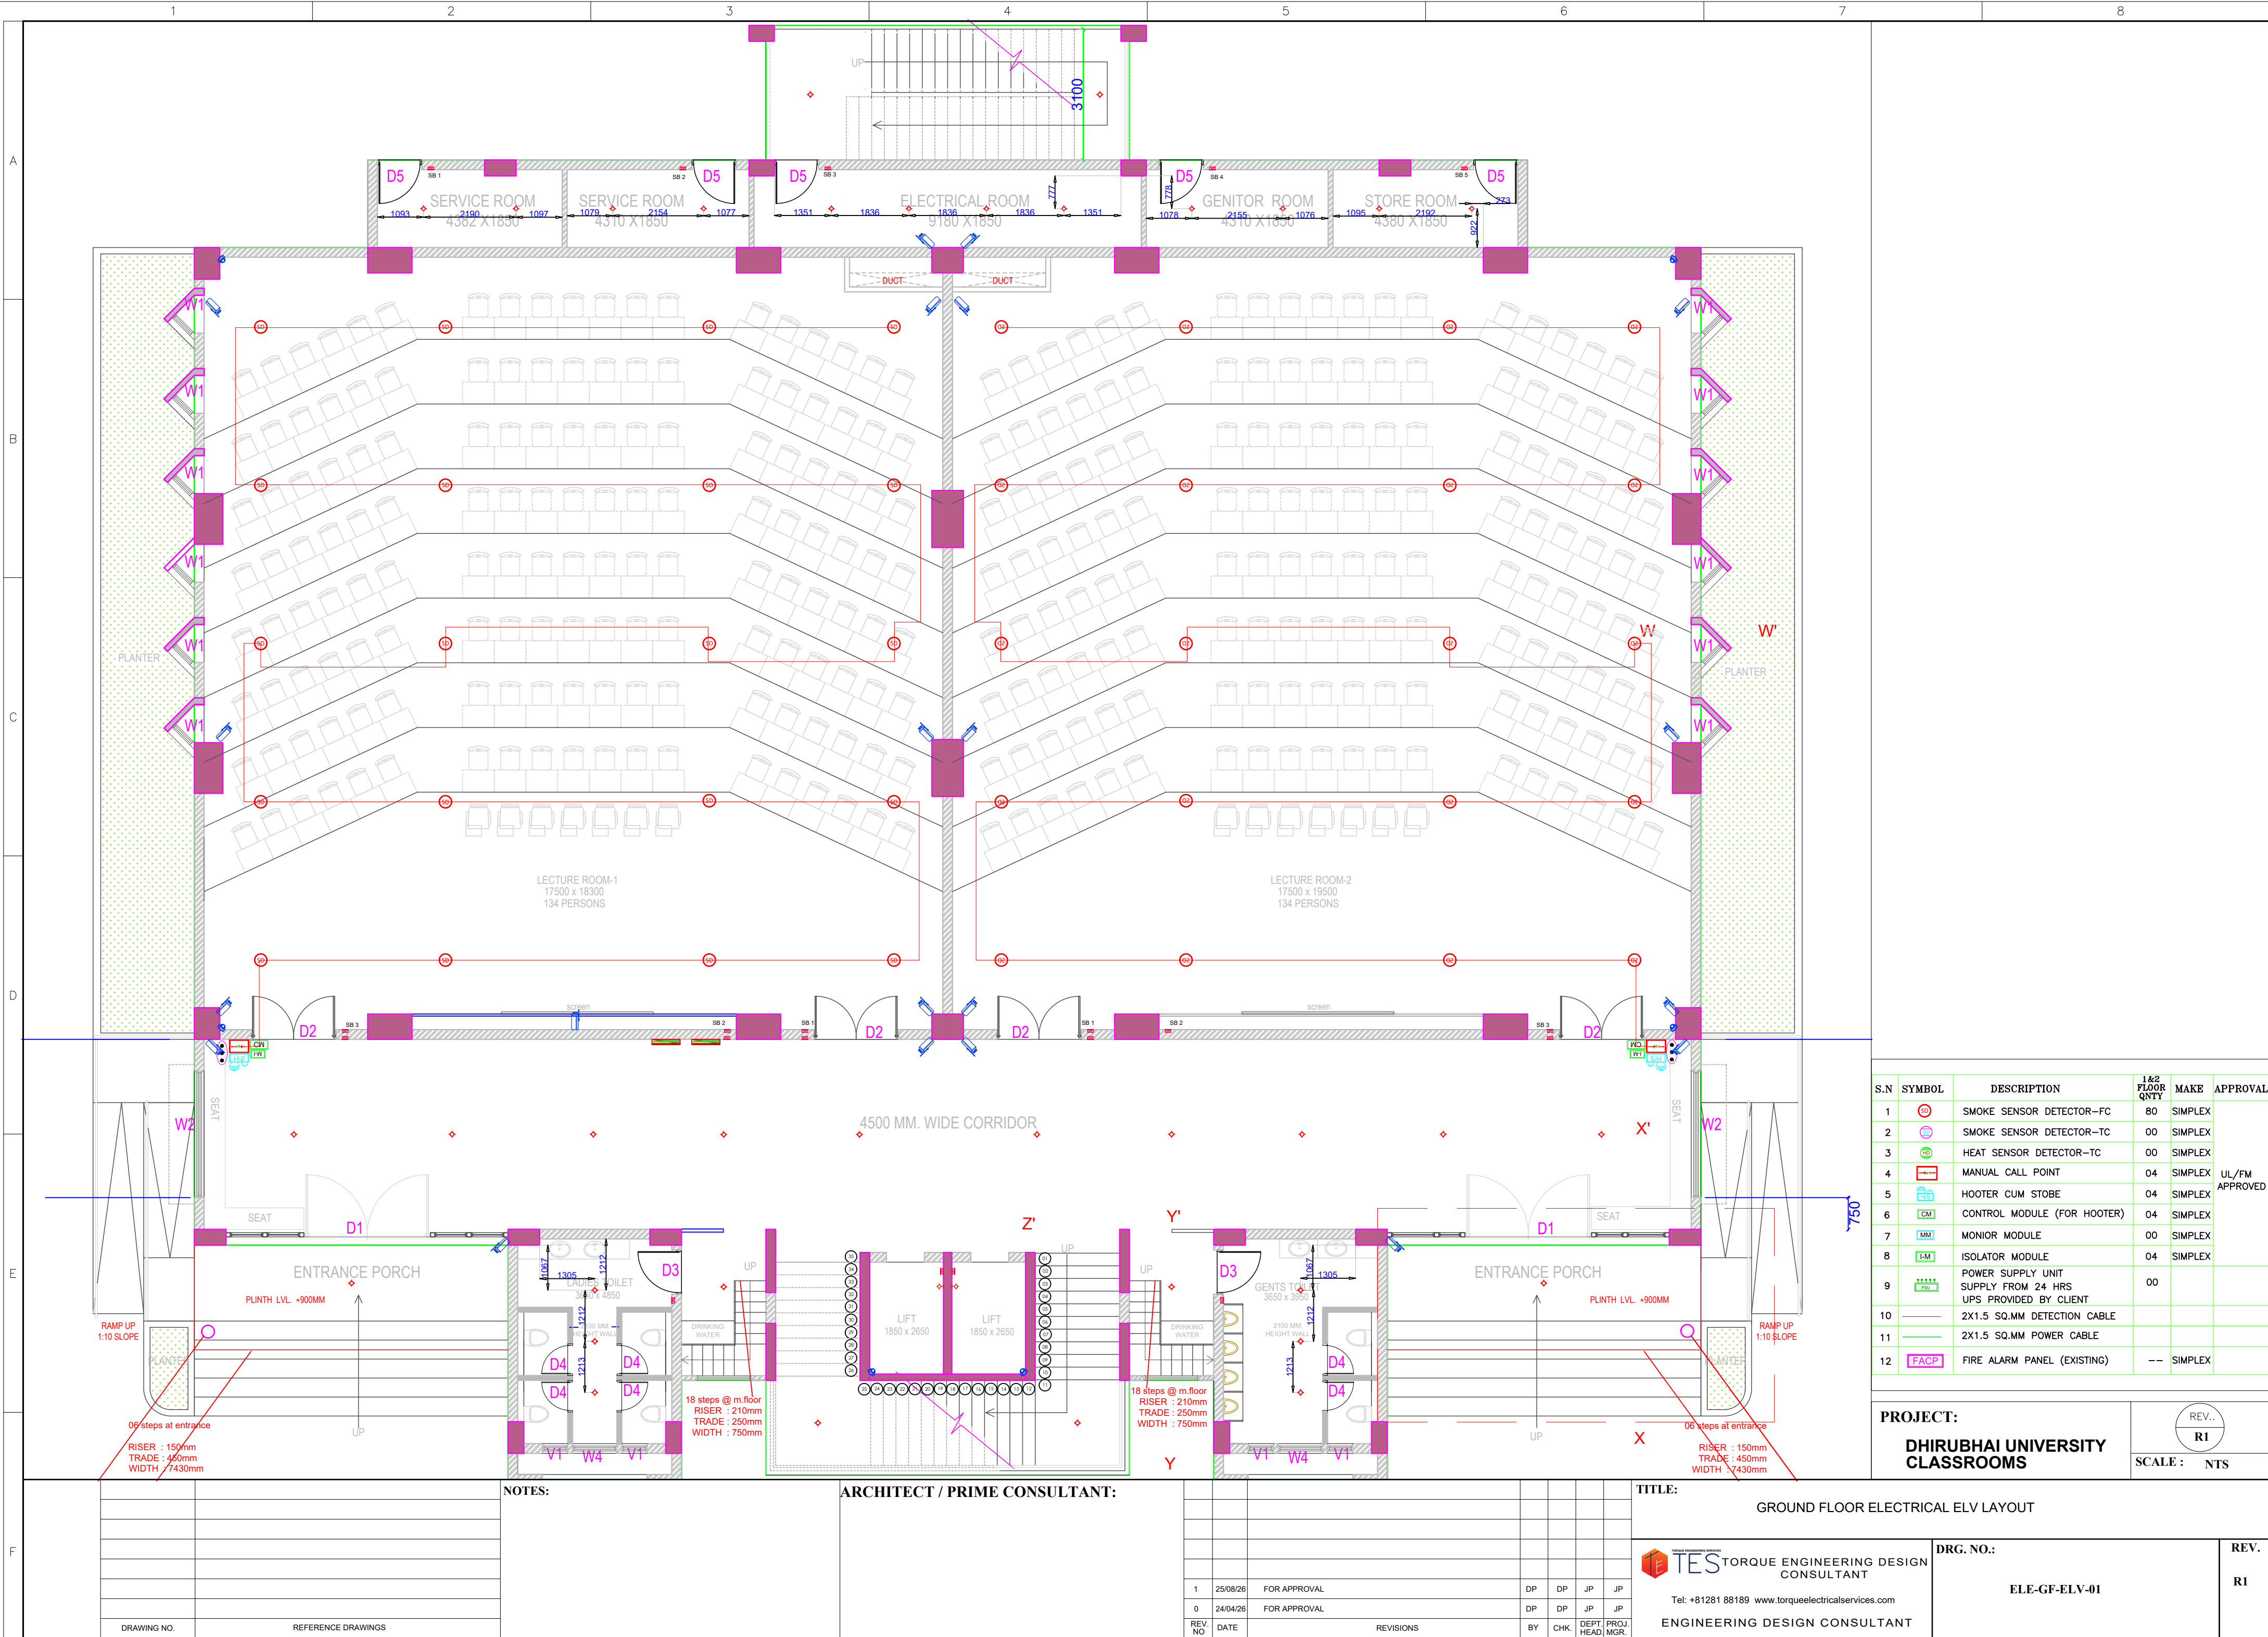

S.N	SYMBOL	DESCRIPTION	1&2 FLOOR QNTY	MAKE	APPROVAL
1		SMOKE SENSOR DETECTOR-FC	80	SIMPLEX	UL/FM APPROVED
2		SMOKE SENSOR DETECTOR-TC	00	SIMPLEX	
3		HEAT SENSOR DETECTOR-TC	00	SIMPLEX	
4		MANUAL CALL POINT	04	SIMPLEX	
5		HOOTER CUM STROBE	04	SIMPLEX	
6		CONTROL MODULE (FOR HOOTER)	04	SIMPLEX	
7		MONIOR MODULE	00	SIMPLEX	
8		ISOLATOR MODULE	04	SIMPLEX	
9		POWER SUPPLY UNIT SUPPLY FROM 24 HRS UPS PROVIDED BY CLIENT	00		
10		2X1.5 SQ.MM DETECTION CABLE			
11		2X1.5 SQ.MM POWER CABLE			
12		FIRE ALARM PANEL (EXISTING)	--	SIMPLEX	

PROJECT:
DHIRUBHAI UNIVERSITY CLASSROOMS

REV..
R1
SCALE : NTS

NOTES:

ARCHITECT / PRIME CONSULTANT:

TITLE:

GROUND FLOOR ELECTRICAL ELV LAYOUT

TORQUE ENGINEERING DESIGN CONSULTANT
Tel: +81281 88189 www.torqueelectricalservices.com
ENGINEERING DESIGN CONSULTANT

DRG. NO.:
ELE-GF-ELV-01

REV.
R1

1	25/08/26	FOR APPROVAL	DP	DP	JP	JP
0	24/04/26	FOR APPROVAL	DP	DP	JP	JP
REV. NO	DATE	REVISIONS	BY	CHK.	DEPT. HEAD	PROJ. MGR.